

TECHNICAL DATA


# Fluke 3PHVL-1730 Cable Assembly, Voltage Test Lead



## Product overview: Fluke 3PHVL-1730 Cable Assembly, Voltage Test Lead

Flat, three phase voltage connection cable for the Fluke 1730 Energy Logger.

## Ordering information

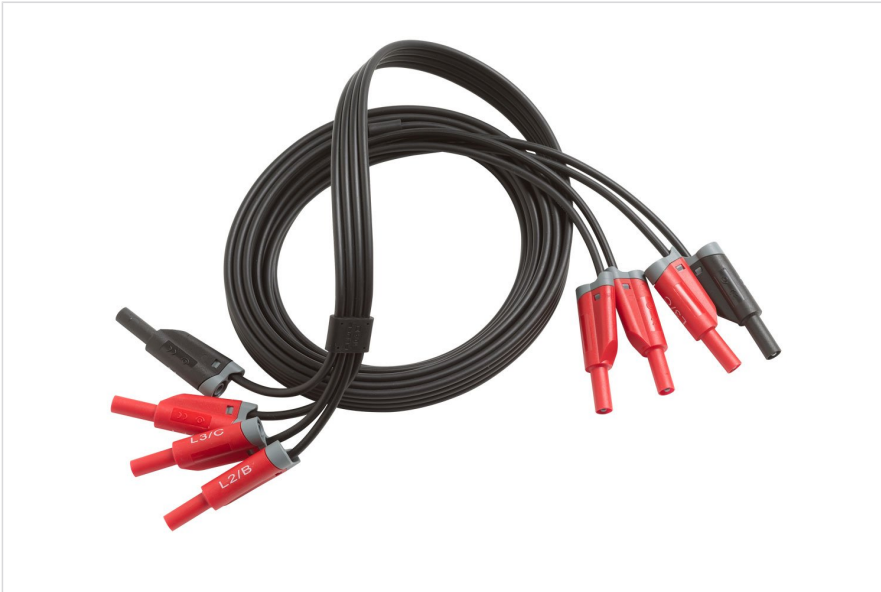

### **Fluke 3PHVL-1730**

Cable Assembly, Voltage Test Lead 3-Phase+N

---

**Fluke.** *Keeping your world up and running.®*

**Fluke (UK) Ltd.**  
52 Hurricane Way  
Norwich, Norfolk  
NR6 6JB  
United Kingdom  
Tel.: +44 (0)20 7942 0708  
E-mail: [cs.uk@fluke.com](mailto:cs.uk@fluke.com)  
[www.fluke.com](http://www.fluke.com)

©2021 Fluke Corporation. All rights reserved.  
Data subject to alteration without notice.  
12/2021

**Modification of this document is not permitted  
without written permission from Fluke Corporation.**