

TECHNICAL DATA


Fluke 3PHVL-1730 Cable Assembly, Voltage Test Lead



Product overview: Fluke 3PHVL-1730 Cable Assembly, Voltage Test Lead

Flat, three phase voltage connection cable for the Fluke 1730 Energy Logger.

Ordering information

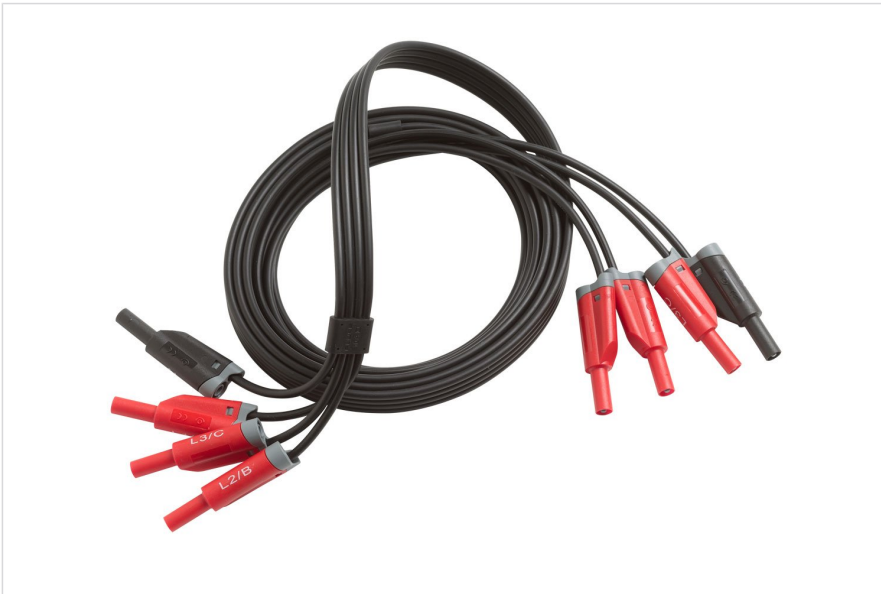

Fluke 3PHVL-1730

Cable Assembly, Voltage Test Lead 3-Phase+N

Fluke. *Keeping your world up and running.®*

Fluke Corporation

PO Box 9090, Everett, WA 98206 U.S.A.

For more information call:

In the U.S.A. (800) 443-5853

In Europe/M-East/Africa

+31 (0)40 267 5100

In Canada (905) 890-7600

From other countries +1 (425) 446-5500

Representative office of Fluke South East Asia Pte Ltd

C/O Danaher Vietnam

Green Power Tower, 11th Floor Unit 2

35 Ton Duch Thang Street, District 1

Ho Chi Minh City

Vietnam

Tel: +84-8-2220-5371 (ext 103)

Email: info.asean@fluke.com

www.fluke.com/vn-vi

©2021 Fluke Corporation. Specifications subject to change without notice.

12/2021

Modification of this document is not permitted without written permission from Fluke Corporation.