

Data teknis


# Fluke TPS FLEX 36 Flexible Current Probe



## Spesifikasi: Fluke TPS FLEX 36 Flexible Current Probe

General Specifications	
Measuring Range selectable per software	30 A to 3000 A
	60 A to 6000 A
Peak current for sinusoidal currents	10 kA
	19 kA
Intrinsic error	1%
Frequency Range	45 Hz to 3.0 kHz
Operating Voltage	300 V CAT IV
Phase Error	0.5°
Jaw Opening	91 cm length
	4 m cable
Errors in % of measuring range at 23°C ± 2 K; 74°F ± 2 K, for 48 to 65 Hz Phase angle error at nominal current I <sub>max</sub> maximum current without time limit (for AC and DC shunts)	

## Model

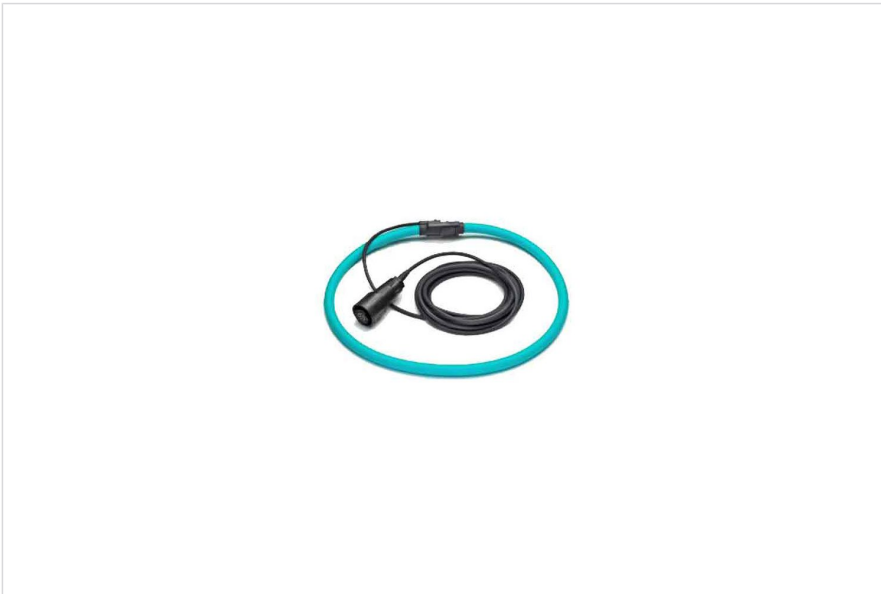

**Fluke TPS FLEX 36**

---

**Fluke.** *Memastikan aktivitas Anda terus berjalan dan beroperasi.*

**Fluke Corporation**

PO Box 9090, Everett, WA 98206 U.S.A.

**For more information call:**

In the U.S.A. (800) 443-5853

In Europe/M-East/Africa

+31 (0)40 267 5100

In Canada (800)-36-FLUKE

From other countries +1 (425) 446-5500

[www.fluke.com](http://www.fluke.com)

**BUT. FLUKE SOUTH EAST ASIA PTE LTD**

Menera Satu Sentra Kelapa Gading #06-05

Jl. Bulevar Kelapa Gading Kav. LA# No. 1

Summarecon Kelapa Gading

Jakarta Utara 14240

Indonesia

Tel: +62 21 2938 5922

Email: [info.asean@fluke.com](mailto:info.asean@fluke.com)

[www.fluke.com/id](http://www.fluke.com/id)

©2021 Fluke Corporation. Specifications subject to change without notice.

12/2021

**Modification of this document is not permitted without written permission from Fluke Corporation.**